

**Technical Data Sheet for AvK-Alternators**

FM 7.3-5

Date:	30/09/13	Customer:	GENERIC DATASHEET only
Project No.:		AvK Reference:	DSG86L1_8_50_400

Object data:

Site:		Prime Mover:	
Application:	Stationary Power Plant	Manufacturer:	

Generator data:

Generator:	DSG 86 L1/8	Poles:	8	Standards:	IEC 60034
Rated power:	1350 kVA	1080 kWe	1136 kWm		
Power factor:	0.80				
Power at pf 1,0	1096 kVA	1096 kWe	1136 kWm		
Rated voltage:	0.4 kV				
Speed:	750 1/min				
Frequency:	50 Hz			Voltage range / frequency range:	
Rated current:	1948.6 A			Zone A according IEC 60034-1 (dU = +/-5%, df = +/-2%)	

Winding pitch:	ca. 5/6
----------------	---------

Insulation class:	Stator: Class H	Rotor: Class H	Temperature rise:	H
-------------------	-----------------	----------------	-------------------	---

Ambient temperature:	40 ° C	Environment:	Standard environment
----------------------	--------	--------------	----------------------

Site altitude:	1000 m		
----------------	--------	--	--

Enclosure:	IP23	Filter:	
------------	------	---------	--

Cooling:	IC 01 - Open-circuit ventilation
----------	----------------------------------

Coolant:	Ambient Air	Temperature	40 ° C	Temperature Air inlet	40 ° C
		Coolant:		generator:	

		Cooling air vol.:	1.7 m³/s	Cooling water quantity:	n/a
--	--	-------------------	----------	-------------------------	-----

Moment of inertia (I):	108 kgm²	Weight:	5000 Kg	Losses (environment):	56 KW
------------------------	----------	---------	---------	-----------------------	-------

		Losses (cooling):	n/a
--	--	-------------------	-----

Wires:	4 terminals, starpoint connected in terminal box
--------	--

Operation mode:	Single mode
-----------------	-------------

Regulators:	
-------------	--

Voltage regulator:	DECS 100
--------------------	----------

Electrical data: (acc. IEC)

Efficiencies:	110%	100%	75%	50%	25%
Power factor 0.8	94,85	95,1	95,3	95,1	93,4
Power factor 0.9	95,59	95,8	95,9	95,6	93,7
Power factor 1.0	96,33	96,5	96,5	96,1	94

Reactances and time constants

	unsaturated		saturated							
	unsaturated	saturated	unsaturated	saturated						
X_d	1.85	1.67 p.u.	X_q	0.93	0.91 p.u.	$T_{d0'}$	1.9 s	$T_{d0''}$	0.02292 s	
X_d'	0.268	0.268 p.u.	X_q'	0.93	0.91 p.u.	$T_{d'}$	0.28 s	$T_{q0'}$	0.26 s	
X_d''	0.167	0.152 p.u.	X_q''	0.167	0.167 p.u.	$T_{d''}$	0.013 s	$T_{q0''}$	0.14479 s	
X_2	0.176	0.160 p.u.	X_0	0.051	0.046 p.u.	T_a	0.036 s	$T_{q'}$	0.26 s	
X_{1s}	n.a.	0.091 p.u.						$T_{q''}$	0.026 s	

Short circuit ratio saturated:	0.6	Z_n	0.119 Ohm
--------------------------------	-----	-------	-----------

Short circuit data:

Initial short circuit current (3-phase):	I_k''	12819 A	
Max. peak current (3-phase):	I_s	32632 A	
Sustained short circuit current:	I_k	5846 A	Minimum 3 x rated current for max.10 s

Initial short circuit torque:	M_{k2}	147.0 kNm
	M_{k3}	88.2 kNm

Max. faulty synchron moment:	M_f	316.1 kNm
------------------------------	-------	-----------

Rated kVA torque:	M_{SN}	17.19 kNm
-------------------	----------	-----------

Rated torque	M_N	13.75 kNm
--------------	-------	-----------

Shaft torque	M_{Sh}	14.46 kNm
--------------	----------	-----------


Load application:

max. load application: 756 kVA (corresponds to 55,97 % from 1350 kVA) for Power factor 0.4 15% transient voltage drop	Power: 1350 kVA Power factor: 0.8 transient voltage drop: -21.1 %
--	---

Remarks:

Alternator :	DSG 86 L1/8			
Rated output [kVA]	1350	Rated power factor:	0.8	Rated voltage [kV]: 0.4
Rated frequency [Hz]	50	Rated speed [rpm]	750	


Wirkungsgrad-Kennlinie - Efficiency Curve

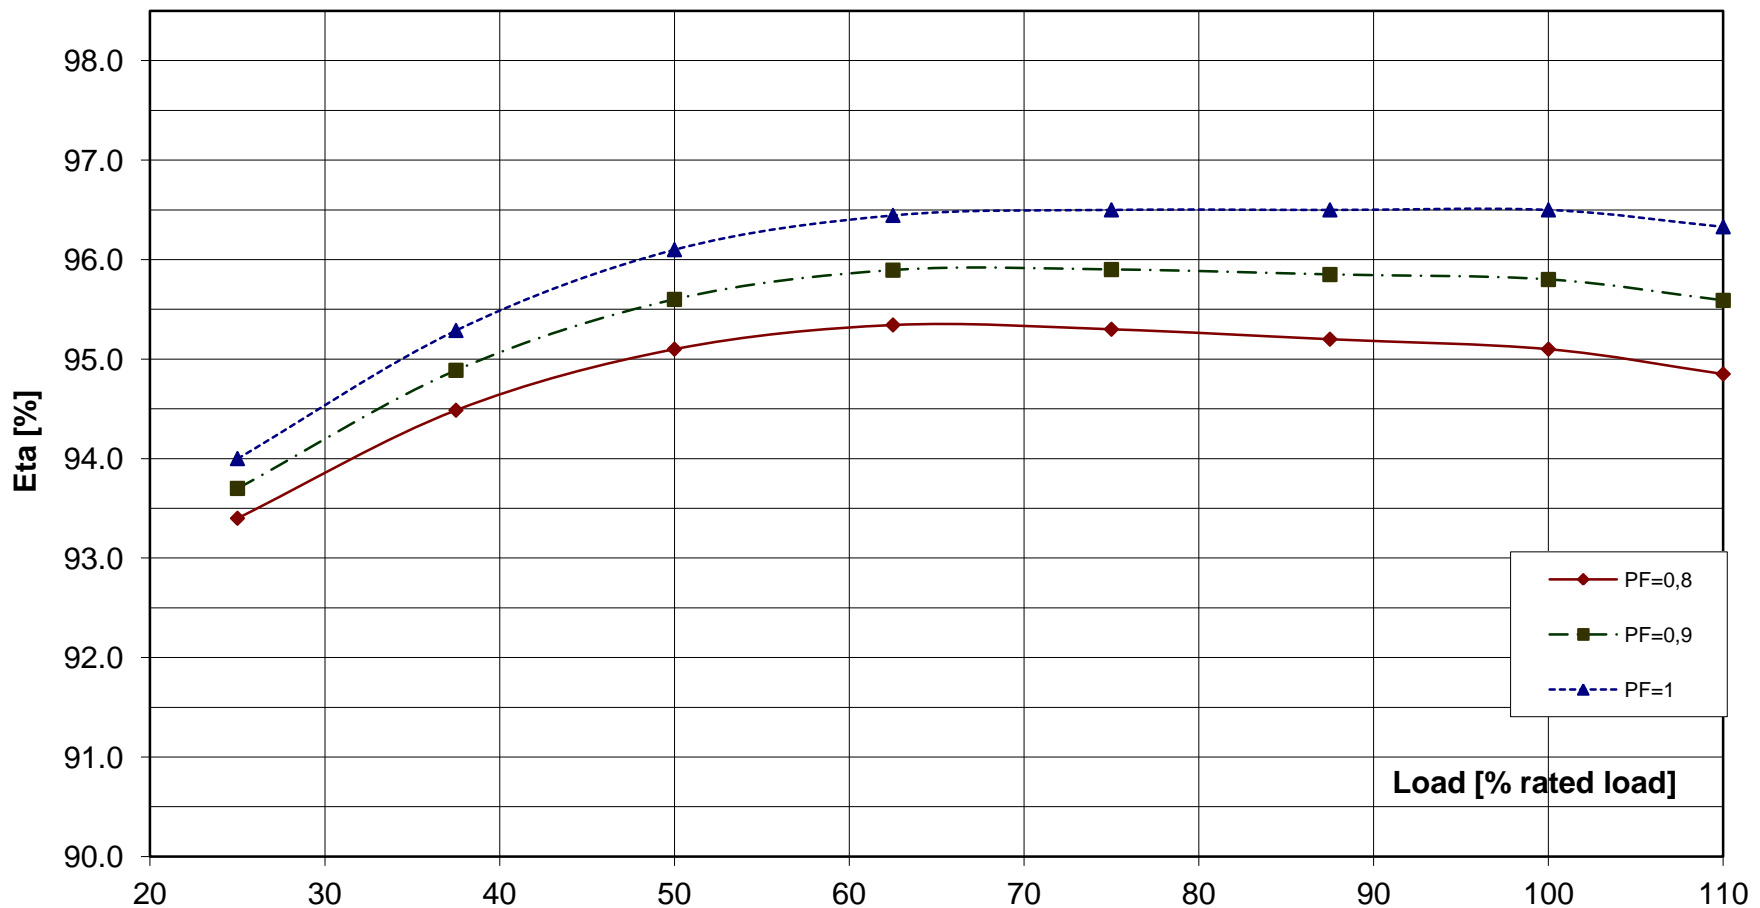

Alternator : DSG 86 L1/8

Rated output [kVA]	1350	Rated power factor:	0.8	Rated voltage [kV]:	0.4
Rated frequency [Hz]	50	Rated speed [rpm]	750		

Transient Voltage rise or drop for sudden load removal or application

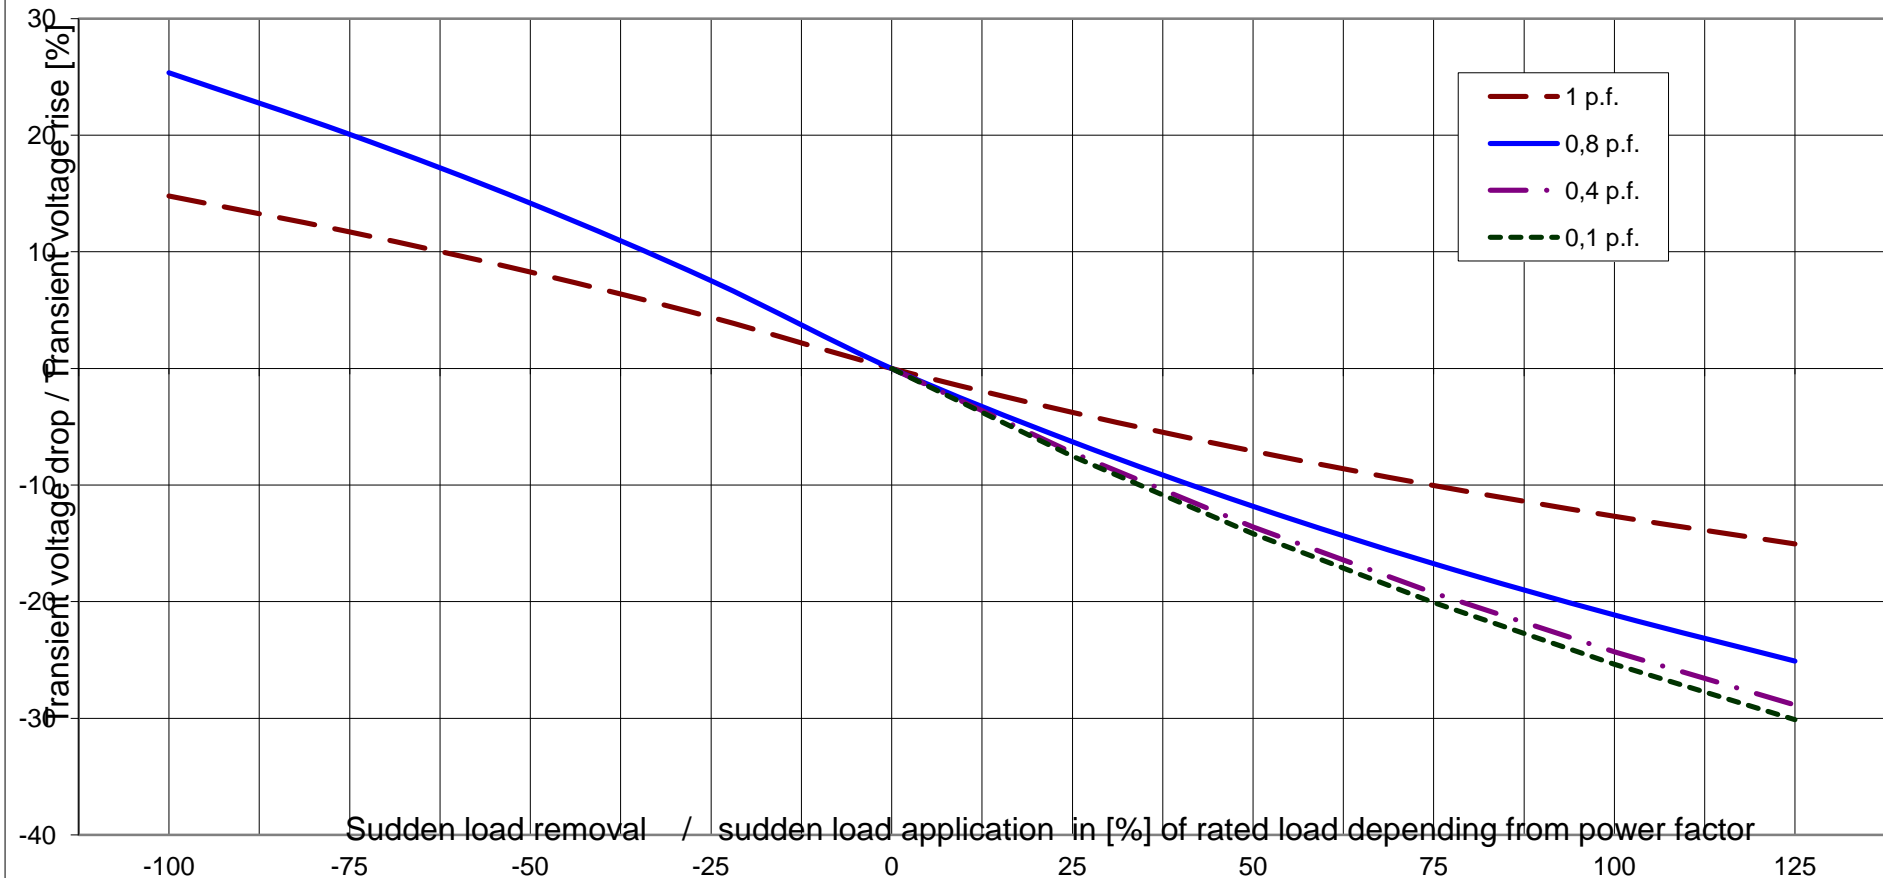




Technisches Datenblatt - Diagramme
Technical data sheet - Diagrams

ING-FCD-0112

Alternator :	DSG 86 L1/8			
Rated output [kVA]	1350	Rated power factor:	0.8	Rated voltage [kV]: 0.4
Rated frequency [Hz]	50	Rated speed [rpm]	750	MSN related to kVA: 17.19 KNm

Kurzschlußmomenten-Verlauf 2-poliger KS
Short circuit torque at 2-phase SC

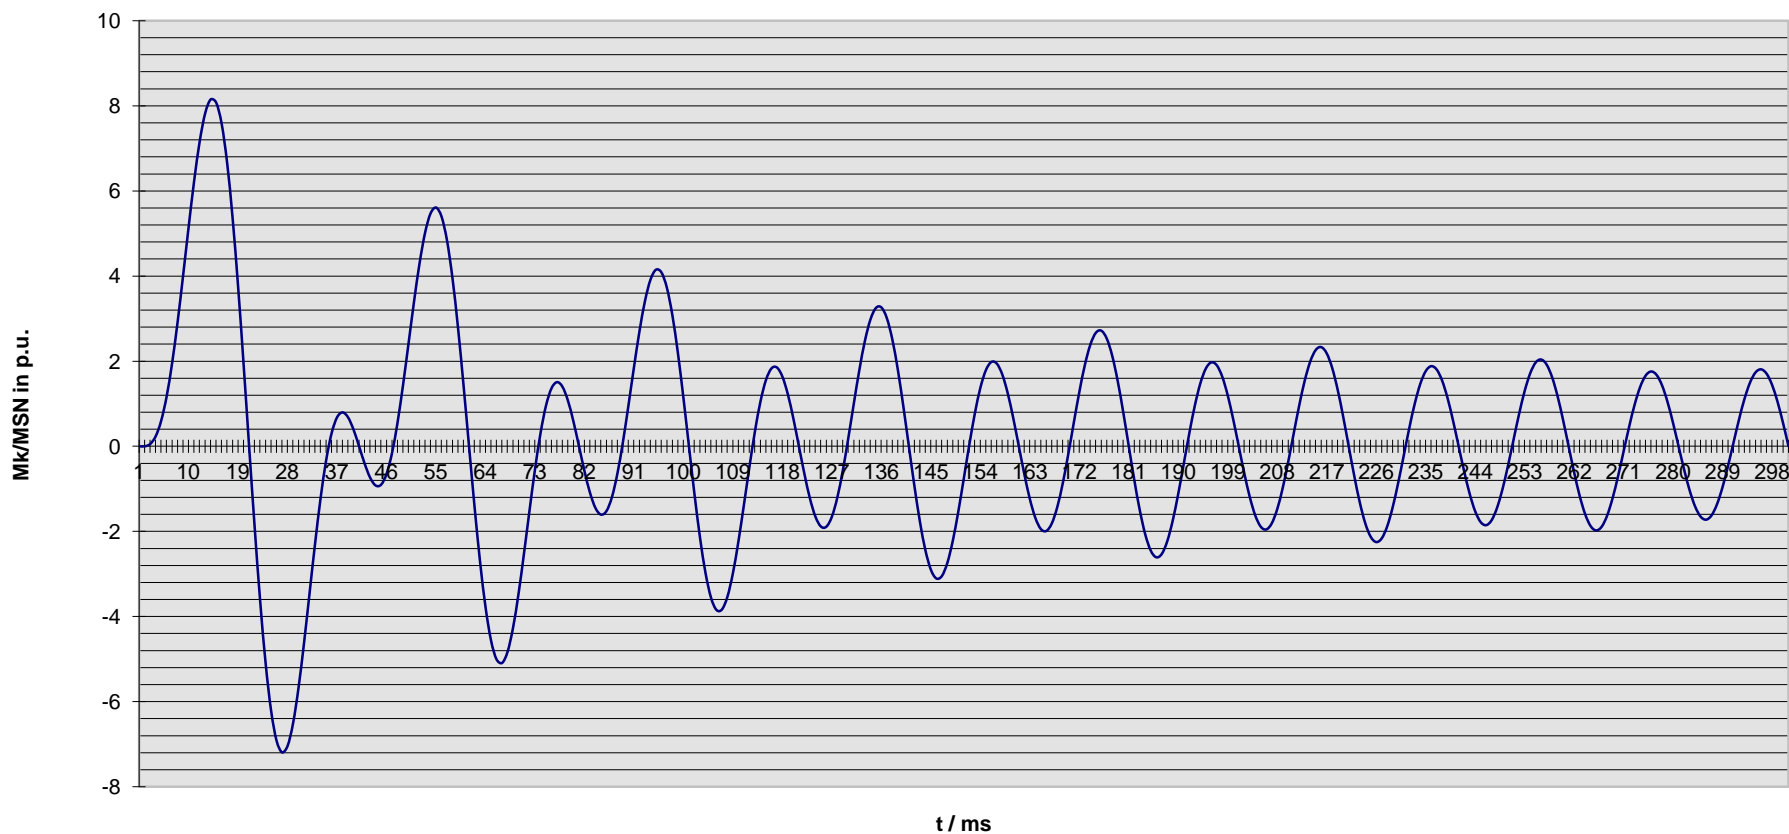

Nenn Daten / nominal data

DSG 86 L1/8

Leistung S_N : **1350 kVA**

$\cos \varphi$: **0.80**

Rating

p.f.

Spannung U_N : **0.40 kV**

Strom I_N : **1949 A**

Voltage

Current

Frequenz f : **50 Hz**

Drehzahl n : **750 min⁻¹**

Frequency


Speed

Schutzart **IP23**

Protection

Kurzschlussstrom $I_{k3\text{phasig}} / I_N$ [p.u.]
 Short-circuit current $I_{k3\text{phase}} / I_N$ [p.u.]

Stosskurzschluss-Strom, 3-phasig, asymmetrisch /
Sudden short circuit current, 3-phase, asymmetrical

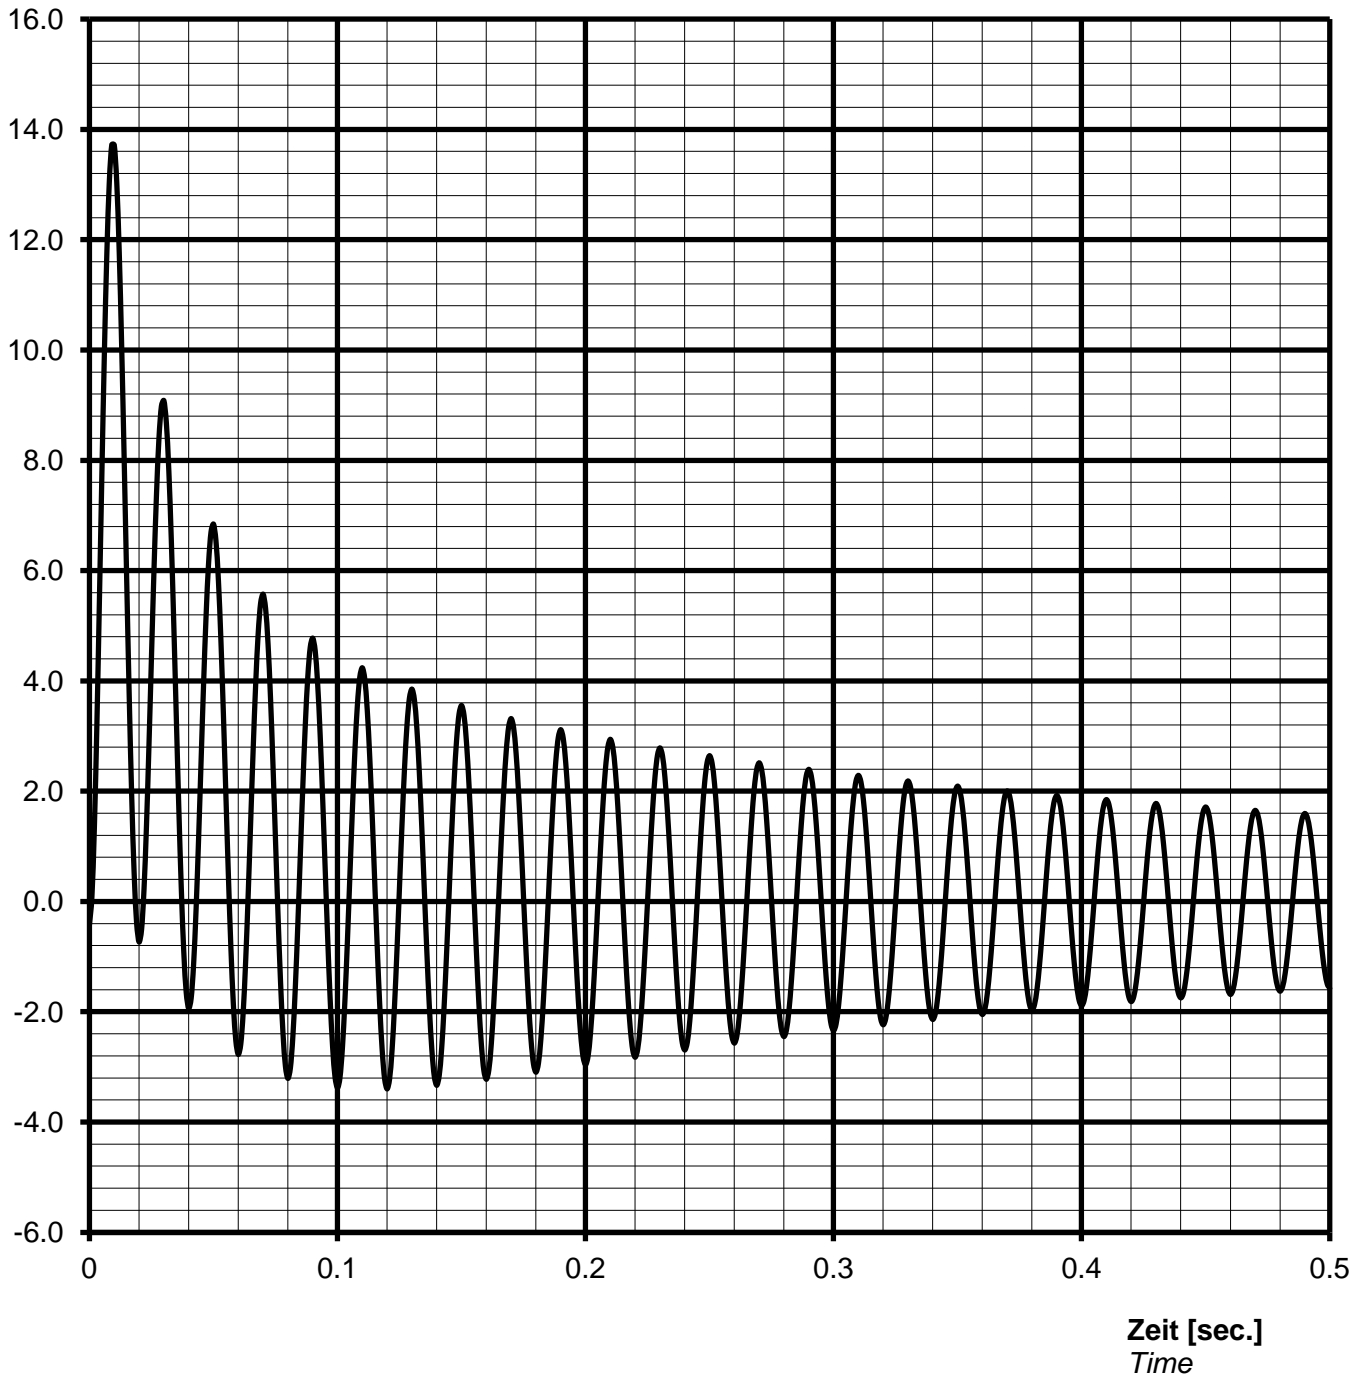

Notizen / remarks:

Maximum asymmetric peak value $I_{\text{peak}} =$ **26735 A** or **13.72 p.u.**

Nenn Daten / nominal data

DSG 86 L1/8

Leistung S_N : **1350 kVA**

$\cos \varphi$: **0.80**

Rating

p.f.

Spannung U_N : **0.40 kV**

Strom I_N : **1949 A**

Voltage

Current

Frequenz f : **50 Hz**

Drehzahl n : **750 min⁻¹**


Frequency

Speed

Schutzart **IP23**

Protection

Überlast Kennlinie
Overload capability

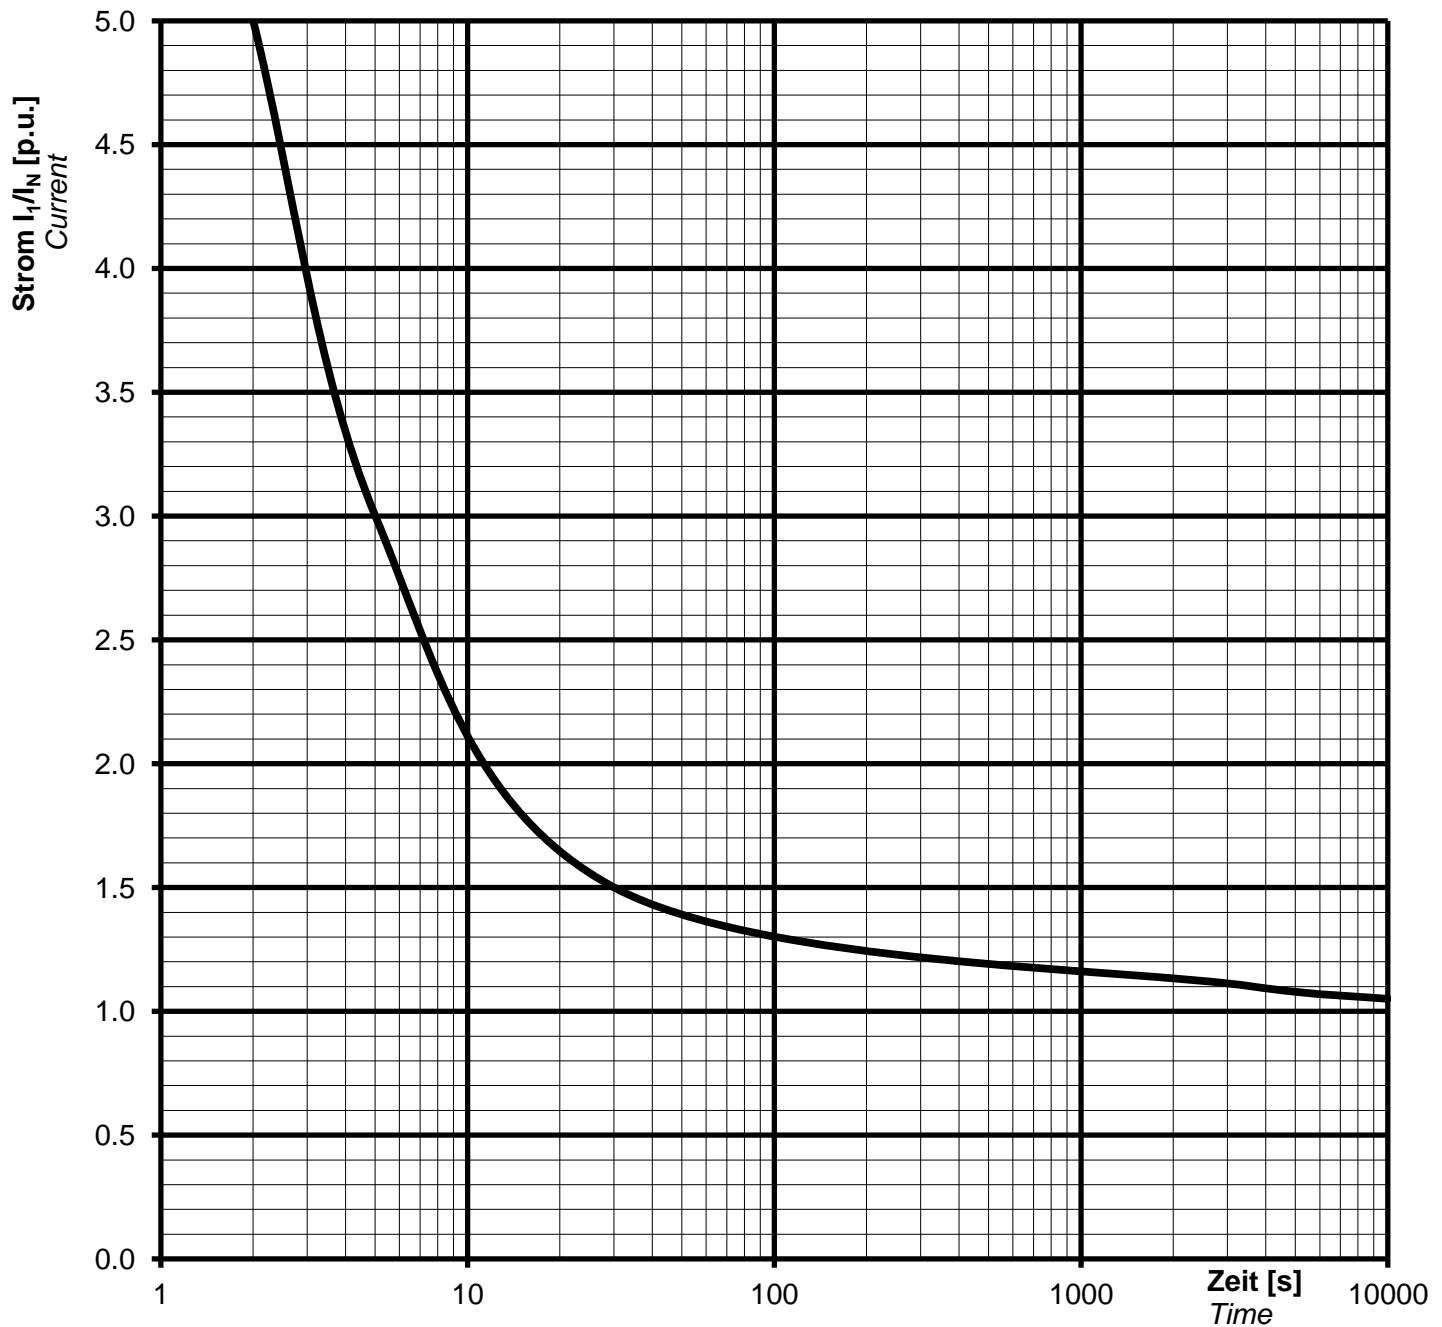

Notizen / remarks:

Strom / Zeit Kriterien:

$$(I / I_N)^2 \cdot t = 45s$$

Current/time characteristics:

1,5 * I_N for 30 s

1,1 * I_N for 1 h in 6h

Nenndaten / nominal data

DSG 86 L1/8

Rating S_N : **1350 kVA**

p.f. **0.80**

Bemessungsleistung

Leistungsfaktor $\cos \varphi$:

Nominal voltage U_N : **0.40 kV**

Nominal current I_N : **1949 A**

Bemessungsspannung

Bemessungsstrom

Frequency f_N : **50 Hz**

Speed n : **750 min⁻¹**


Frequenz

Drehzahl

Protection: **IP23**

Schutzart

Inverse current or unbalanced negative sequence current

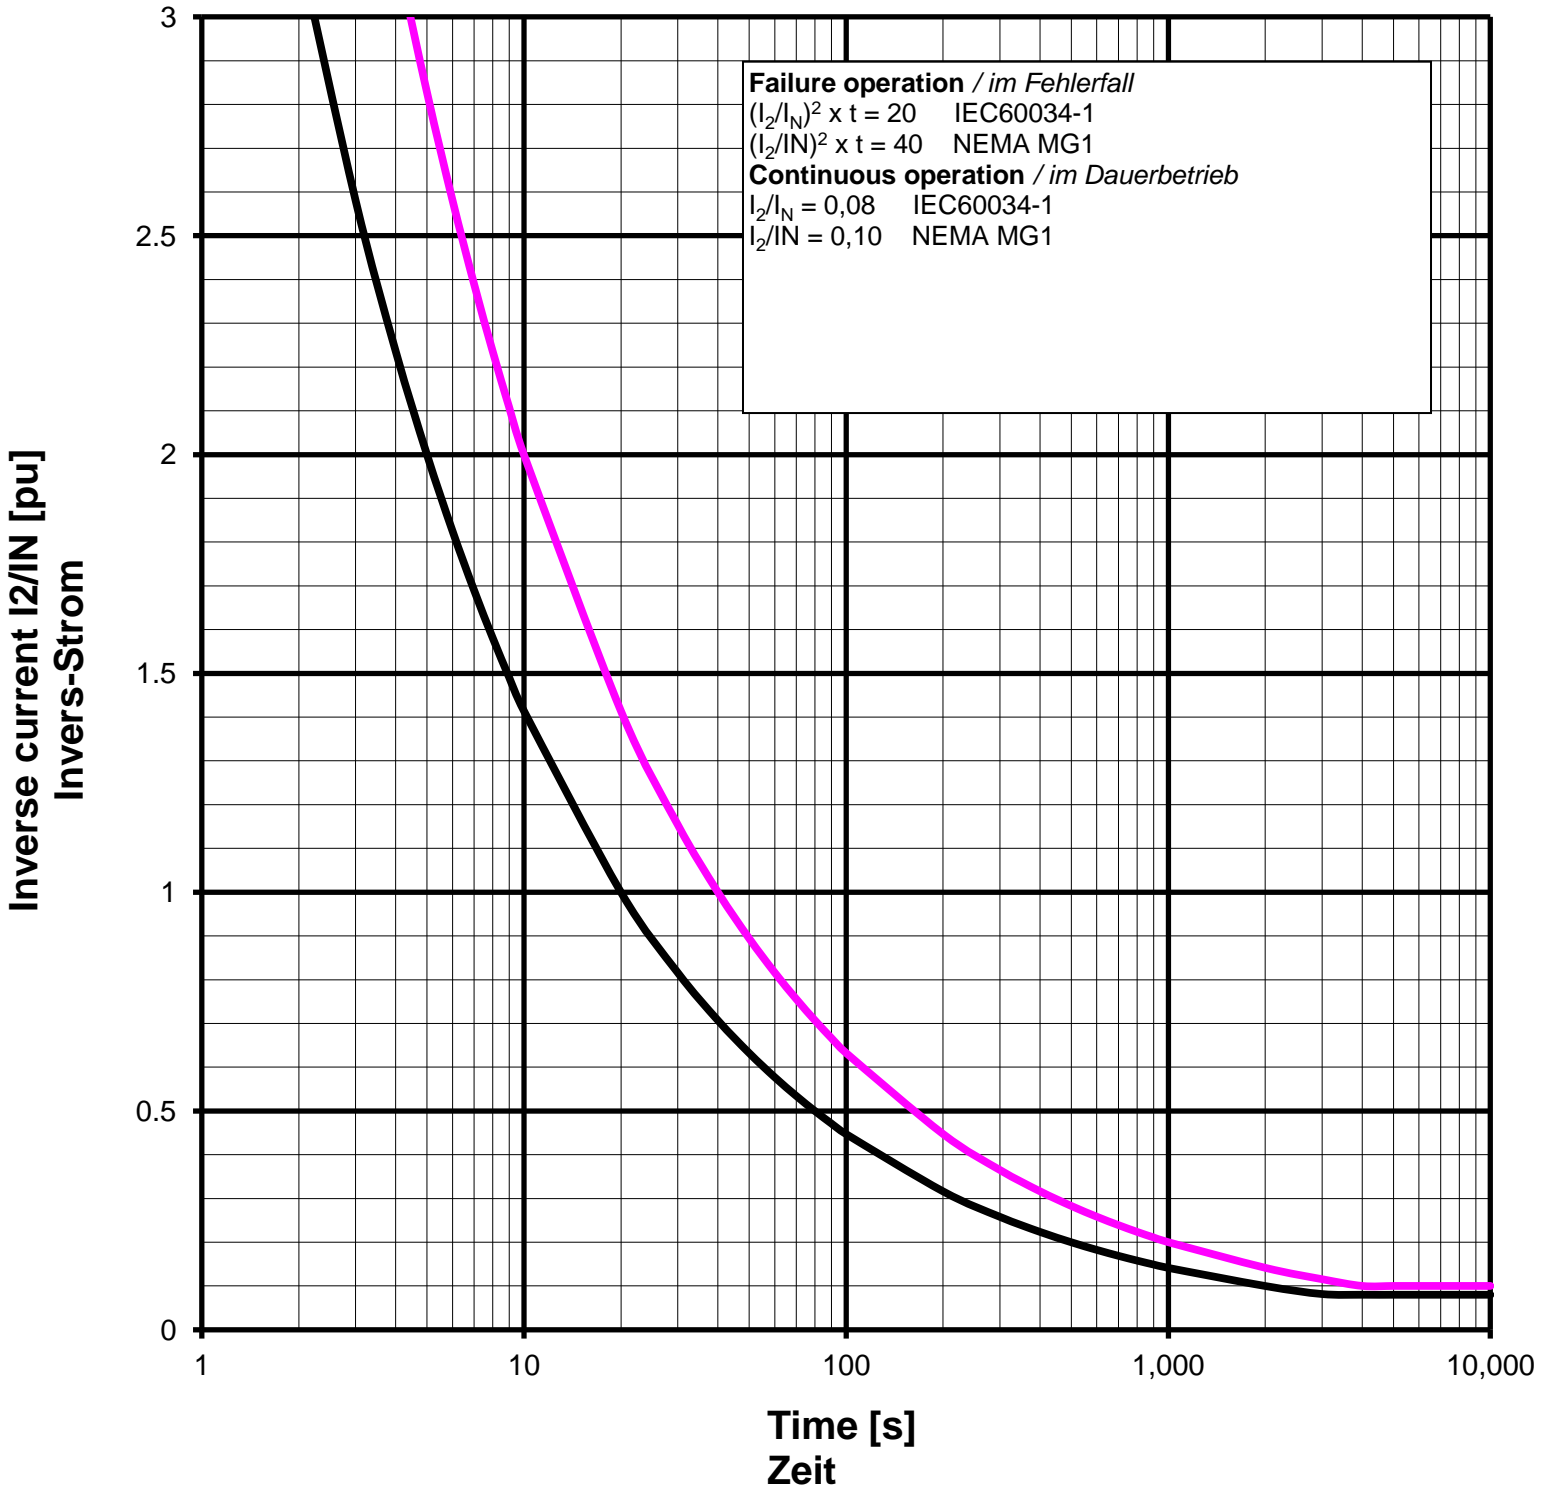

Remarks / Notizen:



Technische Daten selbstregelnden Drehstrom-Synchrongenerator
technical data for self regulating three phase alternator

ING-FCD-0112


TYPE

DSG 86 L1/8

Projekt:

Order Nr.:

Capability (P-Q) Diagram

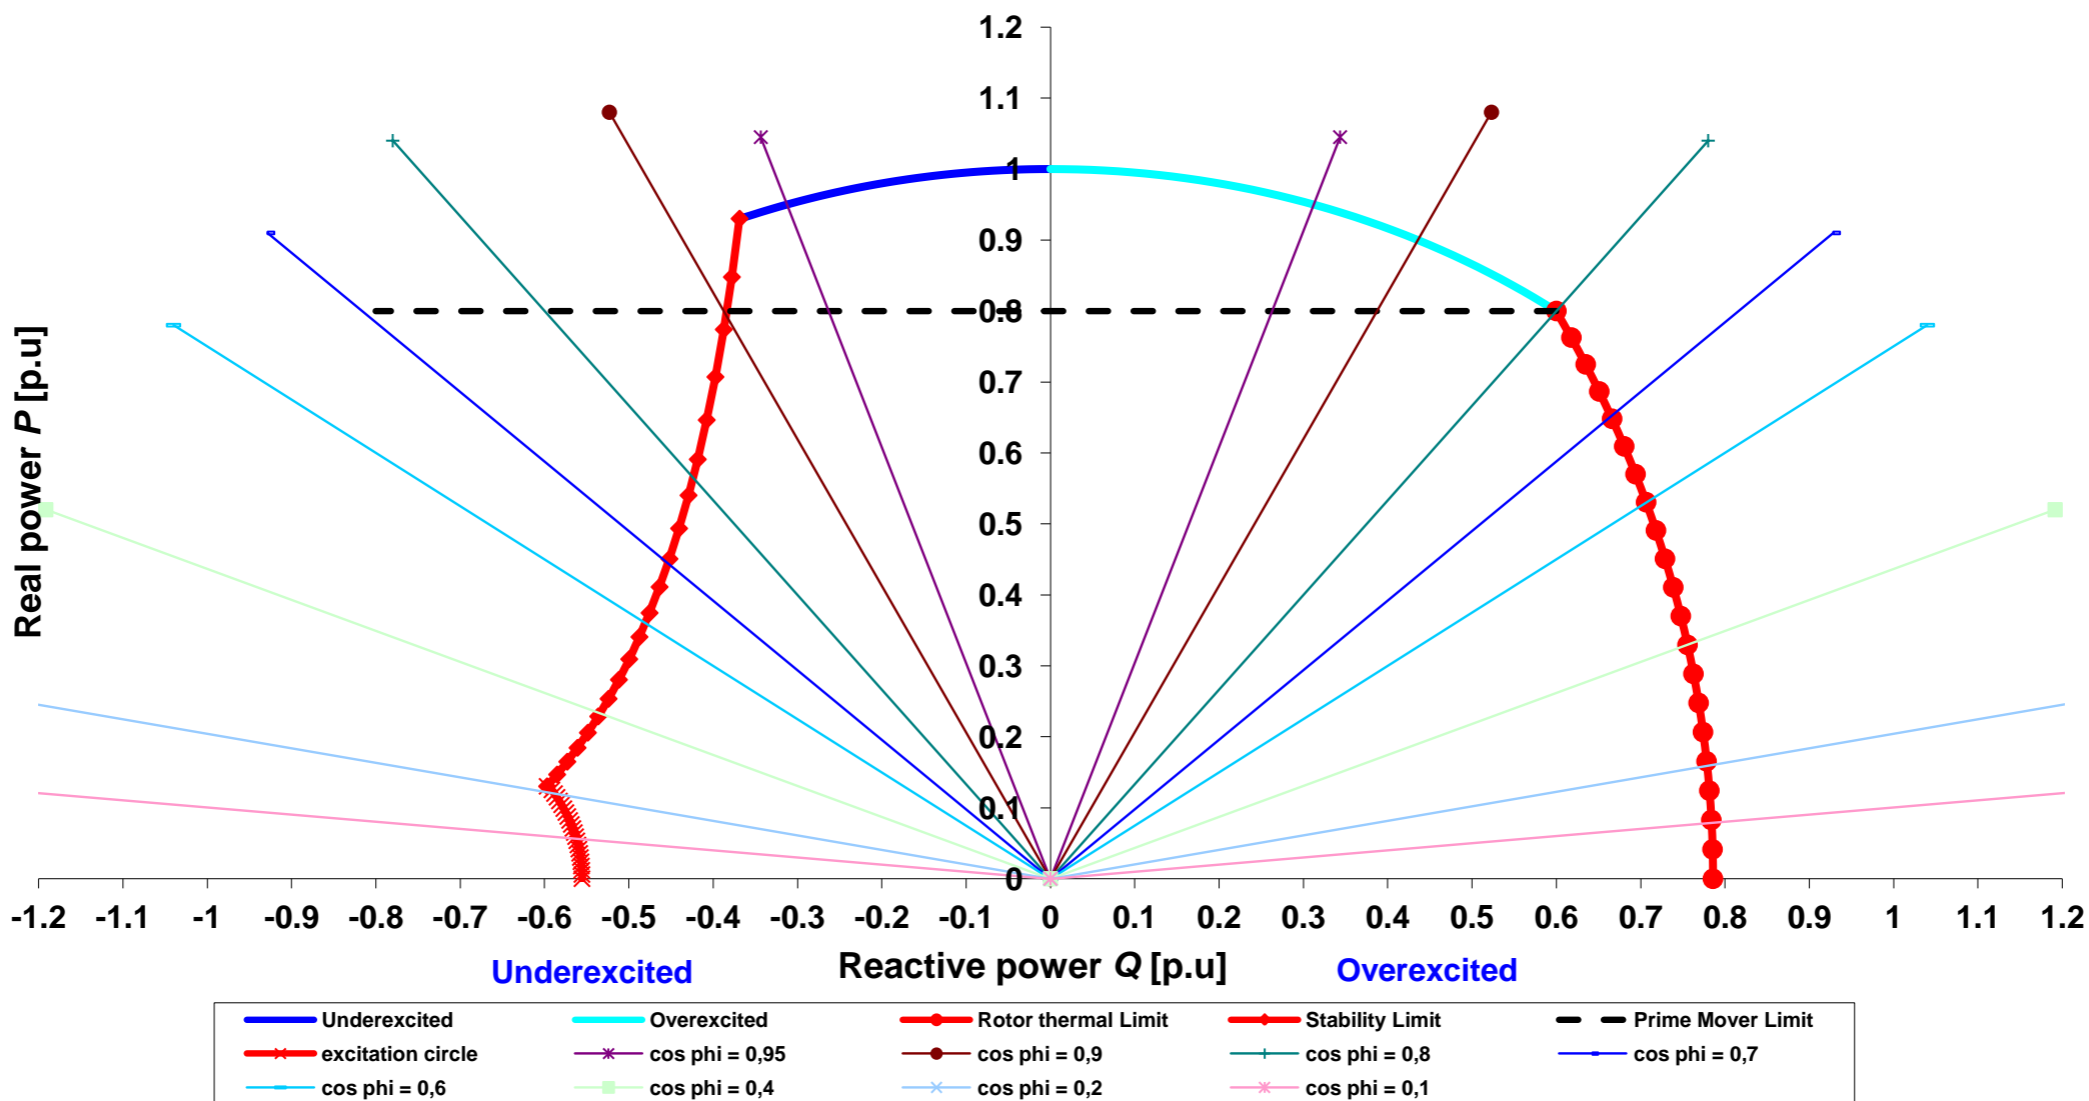

Cummins Generator Technologies

Datum / date:

30/09/2013

